# LENNOX

## HEAT PUMP OUTDOOR UNITS

# **ML17XP1**

**Merit<sup>®</sup> Series** 

R-410A - 60 Hz


RESIDENTIAL **PRODUCT SPECIFICATIONS** 

Bulletin No. 211007 January 2023 Supersedes September 2022





SEER2 up to 17.0 / SEER up to 18.6 HSPF2 up to 8.5 / HSPF up to 10.6 1.5 to 5 Tons Cooling Capacity - 18,000 to 58,000 Btuh Heating Capacity - 16,200 to 54,500 Btuh

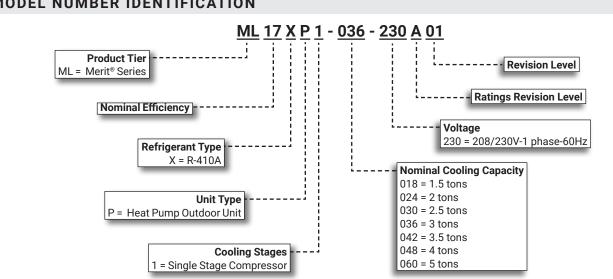

# MODEL NUMBER IDENTIFICATION



- 1. Outdoor Coil Fan
- 2. Quantum<sup>™</sup> Coil
- 3. Expansion Valve Outdoor Unit
- 4. Four-Way Reversing Valve
- 5. High Capacity Liquid Line Drier
- 6. Scroll Compressor
- 7. Defrost Control
- 8. Heavy Gauge Steel Cabinet
- 9. Refrigerant Line Connections

## CONTENTS

Approvals And Warranty
Controls - Order Separately
Dimensions - Unit
Electrical Data
Features
Field Wiring
Installation Clearances
Model Number Identification.
Optional Accessories - Order Separately
Sound Data
Specifications
TXV Substitution
TXV Usage

## APPROVALS AND WARRANTY

## APPROVALS

- AHRI Certified to AHRI Standard 210/240-2023
- For AHRI Certified system match-ups and expanded ratings, visit www.LennoxPros.com
- ENERGY STAR® certified
- Sound rated to AHRI Standard 270-2008 test conditions
- Tested in the Lennox Research Laboratory environmental test room
- Rated according to U.S. Department of Energy (DOE) test procedures
- Units and components UL, NEC, and CEC bonded for grounding to meet safety standards for servicing
- ETL certified (U.S. and Canada)
- ISO 9001 Registered Manufacturing Quality System

## WARRANTY

- Compressor:
  - Limited five years in residential installations
- · Limited five years in non-residential installations
- All other covered components:
  - · Limited five years in residential installations
- · Limited one year in non-residential installations

NOTE - Refer to Lennox® Basic Limited Warranty at www.Lennox.com for additional details.

## FEATURES

## **APPLICATIONS**

- 1.5 through 5 ton
- Sound levels as low as 74 dBA
- Single phase power supply
- Vertical air discharge
- Applicable to indoor air handlers or gas furnaces with indoor add-on coils
- · Shipped completely factory assembled, piped, and wired
- Factory tested operated
- **NOTE** When heat pumps are used with gas furnaces, a dual-fuel compatible thermostat or a zone control system with dual-fuel capabilities must be used (order separately).
- **NOTE** Installer must set heat pump, connect refrigerant lines, and make electrical connections to complete job.

## **REFRIGERATION SYSTEM**

## R-410A Refrigerant

- Non-chlorine, ozone friendly
- Unit is factory pre-charged
- **NOTE** Total system refrigerant charge is dependent on outdoor unit size, indoor unit size and refrigerant line length.
- **NOTE** Refer to the unit-mounted charging sticker to determine correct amount of charge required.

## Outdoor Coil Fan

- Direct drive fan
- Vertical air discharge
- · Fan motor is inherently protected

- Totally enclosed motor
- PSC motor (018, 024, 030 and 036 models)
- ECM motor (042, 048 and 060 models)
- Louvered steel top fan guard
- 2 Quantum™ Coil
  - Lennox designed and fabricated coil
  - Enhanced aluminum alloy tube/enhanced fin coil
  - Ripple-edged aluminum fins
  - Aluminum tube construction
  - · Lanced fins for maximum fin surface exposure
  - · Fin collars grip tubing for maximum contact area
  - Flared shoulder tubing connections
  - Factory tested under high pressure
  - Entire coil is accessible for cleaning

#### **High Pressure Switch**

- Protects the system from high pressure conditions that can be a result of fan failure or a blocked/dirty coil
- Automatic reset

#### Low Pressure Switch

- Shuts off unit if suction pressure falls below setting
- Provides loss of charge and freeze-up protection
- Automatic reset

## 3 Expansion Valve - Outdoor Unit

- Designed and sized for heat pump systems
- Sensing bulb senses evaporator suction temperature during heating cycle

## **FEATURES**

## **REFRIGERATION SYSTEM (continued)**

## 4 Four-Way Reversing Valve

- Rapid changeover of refrigerant flow direction from cooling to heating and vice versa
- Operates on pressure differential between outdoor unit and indoor unit of the system
- Factory installed

## High-Capacity Liquid Line Drier

- Factory installed in the liquid line
- Drier traps moisture or dirt
- 100% molecular-sieve, bead type, bi-flow drier

## **Optional Accessories**

#### Check/Expansion Valve Kits

- Field installed on certain indoor units
- See TXV Usage table
- Chatleff style fitting

#### Freezestat

- Installs on or near the vapor line of the indoor coil or on the suction line
- Senses suction line temperature
- Cycles compressor off when suction line temperature falls below it's setpoint
- Opens at 29°F and closes at 58°F
- Installs on or near the discharge line of the evaporator or on the suction line

#### **Refrigerant Line Kits**

- Refrigerant lines are shipped refrigeration clean
- Lines are cleaned, dried, pressurized and sealed at factory
- Suction line fully insulated
- · Lines are stubbed at both ends

## COMPRESSOR

## 6 Scroll Compressor

- High efficiency with uniform suction flow
- Constant discharge flow, high volumetric efficiency and quiet operation
- Low gas pulses during compression reduces operational sound levels
- Compressor motor is internally protected from excessive current and temperature
- Compressor is installed in the unit on resilient rubber mounts for vibration free operation

#### Scroll Compressor Operation

- Two involute spiral scrolls matched together generate a series of crescent-shaped gas pockets between them
- During compression, one scroll remains stationary while the other scroll orbits around it
- Gas is drawn into the outer pocket, the pocket is sealed as the scroll rotates
- As the spiral movement continues, gas pockets are pushed to the center of the scrolls. Volume between the pockets is simultaneously reduced
- When the pocket reaches the center, gas is now at high pressure and is forced out of a port located in the center of the fixed scrolls
- During compression, several pockets are compressed simultaneously resulting in a smooth continuous compression cycle
- Continuous flank contact, maintained by centrifugal force, minimizes gas leakage and maximizes efficiency
- Compressor is tolerant to the effects of slugging and contaminants. If this occurs, scrolls separate, allowing liquid or contaminants to be worked toward the center and discharged

#### Compressor Crankcase Heater (Factory Installed on 036, 042, 048, 060)

• Protects against refrigerant migration that can occur during low ambient operation

#### **Optional Accessories**

## Crankcase Heater (Optional for 018, 024, 030 models)

• Protects against refrigerant migration that can occur during low ambient operation

#### Compressor Sound Cover

- Reinforced vinyl compressor cover
- 1-1/2 inch thick batt fiberglass insulation
- · Hook and loop fastening tape on all open edges



## **FEATURES**

## **CONTROLS**

## 7 Defrost Control

- Control furnished as standard
- Gives a demand defrost cycle whenever system heating performance falls below optimum levels
- Sensing element on coil determines when defrost cycle is required and when to terminate cycle
- Anti-short cycle (5 minutes) incorporated into the board
- Diagnostic LEDs furnished as an aid in troubleshooting
- · Conveniently located in control box

## **Optional Accessories**

## M30 Smart Wi-Fi Thermostat

 Wi-Fi-enabled, electronic 7-day, universal, multi-stage, programmable, touchscreen thermostat

7:28 pm

- 4 Heat/2 Cool
- · Auto-changeover
- Dual-fuel control with optional outdoor sensor
- Controls dehumidification during cooling mode and humidification during heating mode
- Offers enhanced capabilities including humidification / dehumidification / dewpoint measurement and control, Humiditrol<sup>®</sup> control, and equipment maintenance reminders
- Easy to read 4.3 in. color touchscreen (measured diagonally)
- LCD display with backlight shows the current and set temperature, time, inside relative humidity, system status (operating mode and schedules) and outside temperature (optional outdoor sensor required)
- Smooth Setback Recovery starts system early to achieve setpoint at start of program period
- Compressor short-cycle protection (5 minutes)
- Up to four separate schedules are available plus Schedule IQ<sup>™</sup>
- One-Touch Away Mode A quick and easy way to set the cooling and heating setpoints while away
- Smart Away<sup>™</sup> Uses geo-fencing technology to determine when the homeowner is within a predetermined distance from the home to operate the system when leaving, away and arriving
- Wi-Fi remote monitoring and adjustment through a home wireless network for desktop PCs, laptops and apps for smartphones or tablets
- Smart home automation compatible with Amazon Alexa  $^{\rm \tiny B}$  , Google Assistant and IFTTT
- Service Dashboard features online real-time monitoring of installed Lennox<sup>®</sup> smart thermostats
- **NOTE** See the Lennox<sup>®</sup> M30 Smart Wi-Fi Thermostat Product Specifications bulletin for more information.

## Remote Outdoor Temperature Sensor

- Used with the Lennox<sup>®</sup> M30 Smart Wi-Fi Thermostat
- Outdoor sensor allows thermostat to display outdoor temperature
- **NOTE** Sensor is required for the Enhanced Dehumidification Accessory (EDA) applications.

## Thermostat

- Thermostat is not furnished with unit
- See Lennox Price Book for selection

#### Compressor Hard Start Kit

- Single-phase units are equipped with a PSC compressor motor
- This type of motor normally doesn't need a potential relay and start capacitor
- For conditions such as low voltage kit may be required to increase the compressor starting torque

#### Compressor Low Ambient Cut-Off Switch

- Non-adjustable switch (low ambient cut-out) prevents compressor operation when outdoor temperature is below 35°F
- Freezestat Installs on or near the vapor line of the indoor coil or on the suction line
- Senses suction line temperature and cycles the compressor off when suction line temperature falls below it's setpoint
- Opens at 29°F and closes at 58°F

## Indoor Blower Off Delay Relay

Delays the indoor blower-off time during the cooling cycle

#### Low Ambient Kit


- Air conditioners can operate down to 45°F outdoor air temperature without additional controls
- Allows unit to operate properly down to 30°F
- **NOTE** Crankcase heater and freezestat should be installed on compressors equipped with a low ambient kit.
- **NOTE** A Compressor Low Ambient Cut-Off should be added to terminate compressor operation below recommended operation conditions.

#### Mild Weather Kit

- Units can operate in the heating mode at outdoor air temperatures up to  $75^\circ\mathrm{F}$
- Field installed kit allows heating operation above 75°F

#### Monitor Kit - Service Light

- Ambient compensating thermistor
- Service light thermostat
- · For thermostats requiring indicator light inputs
- · For use with thermostats requiring input for indicator lights



<sup>outside</sup>

LENNOX



## **FEATURES**

#### **CONTROLS** (continued)

## **Optional Accessories (continued)**

#### Outdoor Thermostat Kit

- An outdoor thermostat can be used to lock out some of the electric heating elements on indoor units where twostage control is applicable
- Outdoor thermostat maintains the heating load on the low power input as long as possible before allowing the full power load to come on the line
- Thermostat kit and Mounting Box must be ordered separately

## **CABINET**

- 8 Heavy gauge steel construction
  - Louvered heavy gauge steel panels surround unit on all four sides
  - Five station metal wash process
  - Powder paint finish
  - Control box is conveniently located with all controls factory wired
  - Corner patch plate allows access to compressor components
  - Drainage holes are provided in base section for moisture removal

#### PermaGuard<sup>™</sup> Unit Base

- Durable zinc-coated base section resists rust and corrosion
- 9 R
- Refrigerant Line Connections, Electrical Inlets, Service Valves
  - Sweat connection suction and liquid lines
  - · Located on corner of unit cabinet
  - Suction valve can be fully shut off, while liquid valve may be front seated to manage refrigerant charge while servicing system
  - Refrigerant line connections and field wiring inlets are located in one central area of the cabinet
  - See dimension drawing

#### **Optional Accessories**

#### Unit Stand-Off Kit

- Black high density polyethylene feet
- · Raises unit off of mounting surface
- · Four feet are furnished per order number

SPECIFICATION	S					
General	Μ	odel No.	ML17XP1-018	ML17XP1-024	ML17XP1-030	ML17XP1-036
Data	Nominal	Tonnage	1.5	2	2.5	3
Connections	Liquid line	e OD - in.	3/8	3/8	3/8	3/8
(sweat)	Vapor (Suction) line	e OD - in.	3/4	3/4	3/4	7/8
<sup>1</sup> Refrigerant	R-410A charge	furnished	6 lbs. 2 oz.	6 lbs. 0 oz.	7 lbs. 5 oz.	8 lbs. 9 oz.
Outdoor	Net face area - sq. ft. (	Outer coil	24.5	24.5	18.7	22.2
Coil		Inner coil			18.0	21.5
	Tube dian	neter - in.	5/16	5/16	5/16	5/16
	No	o. of rows	1	1	2	2
	Fins	per inch	22	22	22	22
Outdoor	Dian	neter - in.	22	22	22	26
Fan	No.	of blades	2	2	2	3
		Motor hp	1/8	1/8	1/6	1/5
		Cfm	2840	2840	2670	3590
		Rpm	825	825	825	825
		Watts	127	127	162	200
Shipping Data - Ibs. 1 p	oka.		185	185	185	220
ELECTRICAL DA	-					
Line voltage data - 60			208/230V-1ph	208/230V-1ph	208/230V-1ph	208/230V-1ph
	t protection (MOCP) amp	os	20	25	25	30
<sup>4</sup> Minimum circuit amp	13.6	15.1	15.6	17.8		
Compressor	Rated lo	ad amps	10.3	11.5	11.7	13.1
	Locked ro	tor amps	45.7	59.5	71.3	83.1
Outdoor Fan Motor	0.7	0.7	1.0	1.4		
<b>CONTROLS - OR</b>	DER SEPARATELY	ad amps		1	1	1
M30 Smart Wi-Fi Therr	nostat	15Z69	•	•	•	•
Remote Outdoor Temp	erature Sensor	X2658	•	•	•	•
•	ESSORIES - ORDE	R SEPA	RATELY	1	1	1
Compressor Crankcas	e Heater	93M04	•	•	•	
Compressor Hard Star		88M91	•		•	•
	Copeland	10J42		•		
Compressor Sound Co	· · · · ·	18J42	•	•	•	•
Compressor Low Amb		45F08	•	•	•	•
Freezestat	3/8 in. tubing	93G35	•	•	•	•
	5/8 in. tubing	50A93	•	•	•	•
Indoor Blower Off Dela		58M81	•	•	•	•
<sup>5</sup> Low Ambient Kit		54M89	•	•	•	•
Mild Weather Kit		11B97	•	•	•	•
Monitor Kit - Service L	ight	76F53	•	•	•	•
Outdoor	Thermostat	10Z23	•	•	•	•
Thermostat Kit	Mounting Box	31461	•	•	•	•
Refrigerant	3/8 x 3/4 x 3/8 - 20 ft.	89J56				
Line Sets	3/8 x 3/4 x 3/8 - 30 ft.	89J57				
(Liq. x Suc. OD	3/8 x 3/4 x 3/8 - 40 ft.	89J58	•	•	•	
x Insulation	3/8 x 3/4 x 3/8 - 50 ft.	89J59				
Thickness - Length)	3/8 x 7/8 x 3/8 - 30 ft.	89J60				
	3/8 x 7/8 x 3/8 - 40 ft.	89J61				•
	3/8 x 7/8 x 3/8 - 50 ft.	89J62				
Unit Stand-Off Kit		94J45	•	•	•	•
	range are plus 10% and minus 5			1	1	1

NOTE - Extremes of operating range are plus 10% and minus 5% of line voltage. <sup>1</sup> Refrigerant charge sufficient for 15 ft. length of refrigerant lines. For longer line set requirements see the Installation Instructions for information about line set length and additional refrigerant charge required.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

<sup>4</sup> Crankcase Heater and Freezestat are recommended with Low Ambient Kit.

SPECIFICATIO General		del No.	ML17XP1-042	ML17XP1-048	ML17XP1-060
Data	Nominal T		3.5	4	5
Connections	Liquid line		3/8	3/8	3/8
(sweat)	Vapor (Suction) line		7/8	7/8	1-1/8
<sup>1</sup> Refrigerant	R-410A charge fu		10 lbs. 2 oz.	9 lbs. 2 oz.	10 lbs. 4 oz.
Outdoor	Net face area- sq. ft. O		24.93	24.93	29.09
Coil	•	nner coil	24.13	24.13	28.16
	Tube diame		5/16	5/16	5/16
		of rows	2	2	2
	Fins	per inch	22	22	22
Outdoor		eter - in.	26	26	26
Fan	No. o	f blades	3	3	3
	Ν	/lotor hp	1/3	1/3	1/3
		Cfm	4110	4110	4060
		Rpm	825	825	825
		Watts	213	213	224
Shipping Data - Ibs. 1	1 pkg.		250	250	260
ELECTRICAL D		1			
Line voltage data - 6			208/230V-1ph	208/230V-1ph	208/230V-1ph
	ent protection (MOCP) amps		40	50	50
<sup>3</sup> Minimum circuit am	· · · · · ·	,	25.9	33.9	32.5
Compressor	Rated loa	ad amos	18.6	25	23.9
	Locked rote	· –	110	120	124.5
Outdoor Fan Motor		ad amps	2.4 - 2.6	2.4 - 2.6	2.4 - 2.6
	RDER SEPARATELY		2.1 2.0	2.1 2.0	2.1 2.0
M30 Smart Wi-Fi The		15Z69	•	•	•
Remote Outdoor Ten		X2658	•	•	•
	CESSORIES - ORDER				-
		1	AIELI	1	1
Compressor Hard St		88M91			•
	LG	10J42	•	•	
Compressor Sound		18J42	•	•	•
Compressor Low Am		45F08	٠	•	•
Freezestat	3/8 in. tubing	93G35	٠	•	•
	5/8 in. tubing	50A93	•	•	•
Indoor Blower Off De	elay Kelay	58M81	•	•	•
<sup>4</sup> Low Ambient Kit		54M89	•	•	•
Mild Weather Kit	Linkt	11B97	•	•	•
Monitor Kit - Service		76F53	•	•	•
Outdoor Thermostat Kit	Thermostat	10Z23	٠	•	•
	Mounting Box	31461	٠	•	•
Refrigerant Line Sets	3/8 x 7/8 x 3/8 - 30 ft.	89J60			
LINE JELS	3/8 x 7/8 x 3/8 - 40 ft.	89J61	•	•	
	3/8 x 7/8 x 3/8 - 50 ft.	89J62			
(Liq. x Suc. OD x Insulation	010 4 410 010 00 5	Vo			
(Liq. x Suc. OD x Insulation Thickness - Length)	3/8 x 1-1/8 x 3/8 - 30 ft. 3/8 x 1-1/8 x 3/8 - 50 ft.	X0570 73P91			•

NOTE - Extremes of operating range are plus 10% and minus 5% of line voltage.

<sup>1</sup> Refrigerant charge sufficient for 15 ft. length of refrigerant lines. For longer line set requirements see the Installation Instructions for information about line set length and additional refrigerant charge required.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

<sup>4</sup> Crankcase Heater and Freezestat are recommended with Low Ambient Kit.

SOUND	DATA												
<sup>1</sup> Model Octave Band Sound Power Levels dBA, re 10 <sup>-12</sup> Watts Center Frequency - HZ								<sup>1</sup> Sound <sup>2</sup> Estimated Sound Press Rating Distance From Unit (dBA at					
model	125	250	500	1000	2000	4000	8000	Number (dBA)	3	5	10	15	50
018	56.5	62	68.0	71.5	66.0	57.0	50	74	67	62	56	53	42
024	56.0	62	66.5	71.0	66	60	55.0	74	67	62	56	53	42
030	56.0	64	69.5	70.0	65	59	52.5	74	67	62	56	53	42
036	59	68	71.5	68.5	66	61	54	75	68	63	57	54	43
042	62	71.0	74.5	72.5	70	63	55.5	78	71	66	60	57	46
048	61	70.5	75.5	73.0	70	64	56.0	79	72	67	61	58	47
060	61.5	70.0	73.0	71	71	68	63	79	73	68	62	59	48

NOTE - the octave sound power data does not include tonal correction.


<sup>1</sup> Tested according to AHRI Standard 270-2008 test conditions.

<sup>2</sup> Estimated sound pressure level at distance based on AHRI Standard 275-2010 method for equipment located on the ground, roof, or on side of building wall with no adjacent reflective surface within 9.8 feet. Sound pressure levels will increase based on changes to assumptions. For other applications, refer to AHRI Standard 275.

## **FIELD WIRING**

- A Two Wire Power (see Electrical Data)
- B Two or Three Wire Power (size to heater capacity)
- C Twelve Wire Low Voltage 18 ga. minimum Fourteen Wire Low Voltage with Optional Outdoor Thermostat
- D Eight Wire Low Voltage 18 ga. minimum Ten Wire Low Voltage with Optional Outdoor Thermostat NOTE - Field Wiring Not Furnished

All wiring must conform to NEC or CEC and local electrical codes.

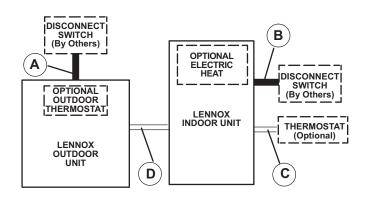

## **INSTALLATION CLEARANCES**

#### NOTES:


Service clearance of 30 in. (762 mm) must be maintained on one of the sides adjacent to the control box.


Clearance to one of the other three sides must be 36 in. (914 mm)

Clearance to one of the remaining two sides may be 12 in. (305 mm) and the final side may be 6 in. (152 mm).

A clearance of 24 in. must be maintained between two units.

48 in. (1219 mm) clearance required on top of unit.



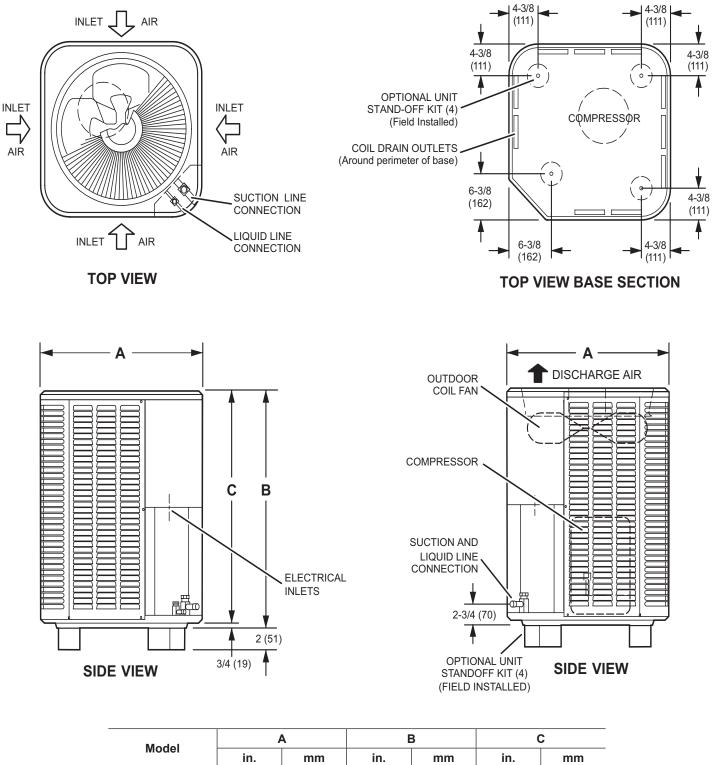

Model		4	E	3	С	
WOUEI	in.	mm	in.	mm	in.	mm
018	28-1/4	718	43-1/4	1099	42-1/2	1080
024	28-1/4	718	43-1/4	1099	42-1/2	1080
030	28-1/4	718	33-1/4	845	32-1/2	826
036	32-1/4	817	33-1/4	845	32-1/2	826
042	32-1/4	817	37-1/4	946	36-1/2	927
048	32-1/4	817	37-1/4	946	36-1/2	927
060	32-1/4	817	43-1/4	1099	42-1/2	1080

## **TXV USAGE**

Use this table for C35, CH23 and CR33 Field Installed TXV Match-Ups

Model	Order No.
018	12J18
024	12J18
030	12J18
036	12J19
042	12J20
048	12J20
060	12J20

CX35 and CHX35 coils and all Lennox air handlers are shipped with a factory installed TXV.

C35 coils - Replace the factory installed RFC orifice with the expansion valve listed.

CH23 and CR33 - Use the expansion valve listed.

## AHRI STANDARD 210/240-2023

Standard Ratings relating to cooling or heating capacities shall be net values, including the effects of circulating-fan heat, but not including supplementary electric heat. Power input used for calculating efficiency shall be the Total Power.

Standard Ratings of units which do not have indoor aircirculating fans furnished as part of the model, i.e., Coilonly System, shall be established by subtracting from the total cooling capacity 1,505 Btu/h per 1,000 SCFM, and by adding the same amount to the heating capacity for nonmobile-home, non-Space Constrained units. Total Power for both heating and cooling shall be increased by 441 W per 1,000 SCFM of indoor air circulated.

## **TXV SUBSTITUTION**

A general guide for replacing the factory installed TXV if the indoor unit (coil/air handler) is larger or smaller than the outdoor unit.

Outdo	or Unit	Indoo	r Unit	TXV	TXV
Size	Tons	Size	Tons	Furnished	Replacement
018	1.5	30/36	2.5/3	12J19	12J18
018	1.5	36	3	12J19	12J18
018	1.5	42	3.5	12J20	12J18
018	1.5	48	4	12J20	12J18
018	1.5	49	4	12J20	12J18
018	1.5	50/60	4/5	12J20	12J18
018	1.5	51/61	4/5	12J20	12J18
018	1.5	60	5	12J20	12J18
024	2	42	3.5	12J20	12J18
024	2	48	4	12J20	12J18
024	2	49	4	12J20	12J18
024	2	50/60	5	12J20	12J18
024	2	51/61	5	12J20	12J18
024	2	60	5	12J20	12J18
030	2.5	42	3.5	12J20	12J18
030	2.5	43	3.5	12J20	12J18
030	2.5	48	4	12J20	12J18
030	2.5	49	4	12J20	12J18
036	3	24	2	12J18	12J19
036	3	30	2.5	12J18	12J19
042	3.5	24	2	12J18	12J20
042	3.5	30	2.5	12J18	12J20
042	3.5	30/36	3	12J19	12J20
042	3.5	36	3	12J19	12J20
048	4	30/36	2.5/3	12J19	12J20
048	4	36	3	12J19	12J20

TXV Ranges:

12J18 - 1.5 to 2.5 ton systems - Use on 2.5 ton (030) and lower systems.

12J19 - 3 ton systems - Use down to 2 ton (024) systems.

12J20 - 3.5 to 5 ton systems - Use down to 3 ton (036) systems.

## REVISIONS

Section	Description
Optional Accessories	Updated Line Sets available.









Visit us at www.Lennox.com For the latest technical information, www.LennoxPros.com Contact us at 1-800-9-LENNOX

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.